


PŮDORYS 1.NP

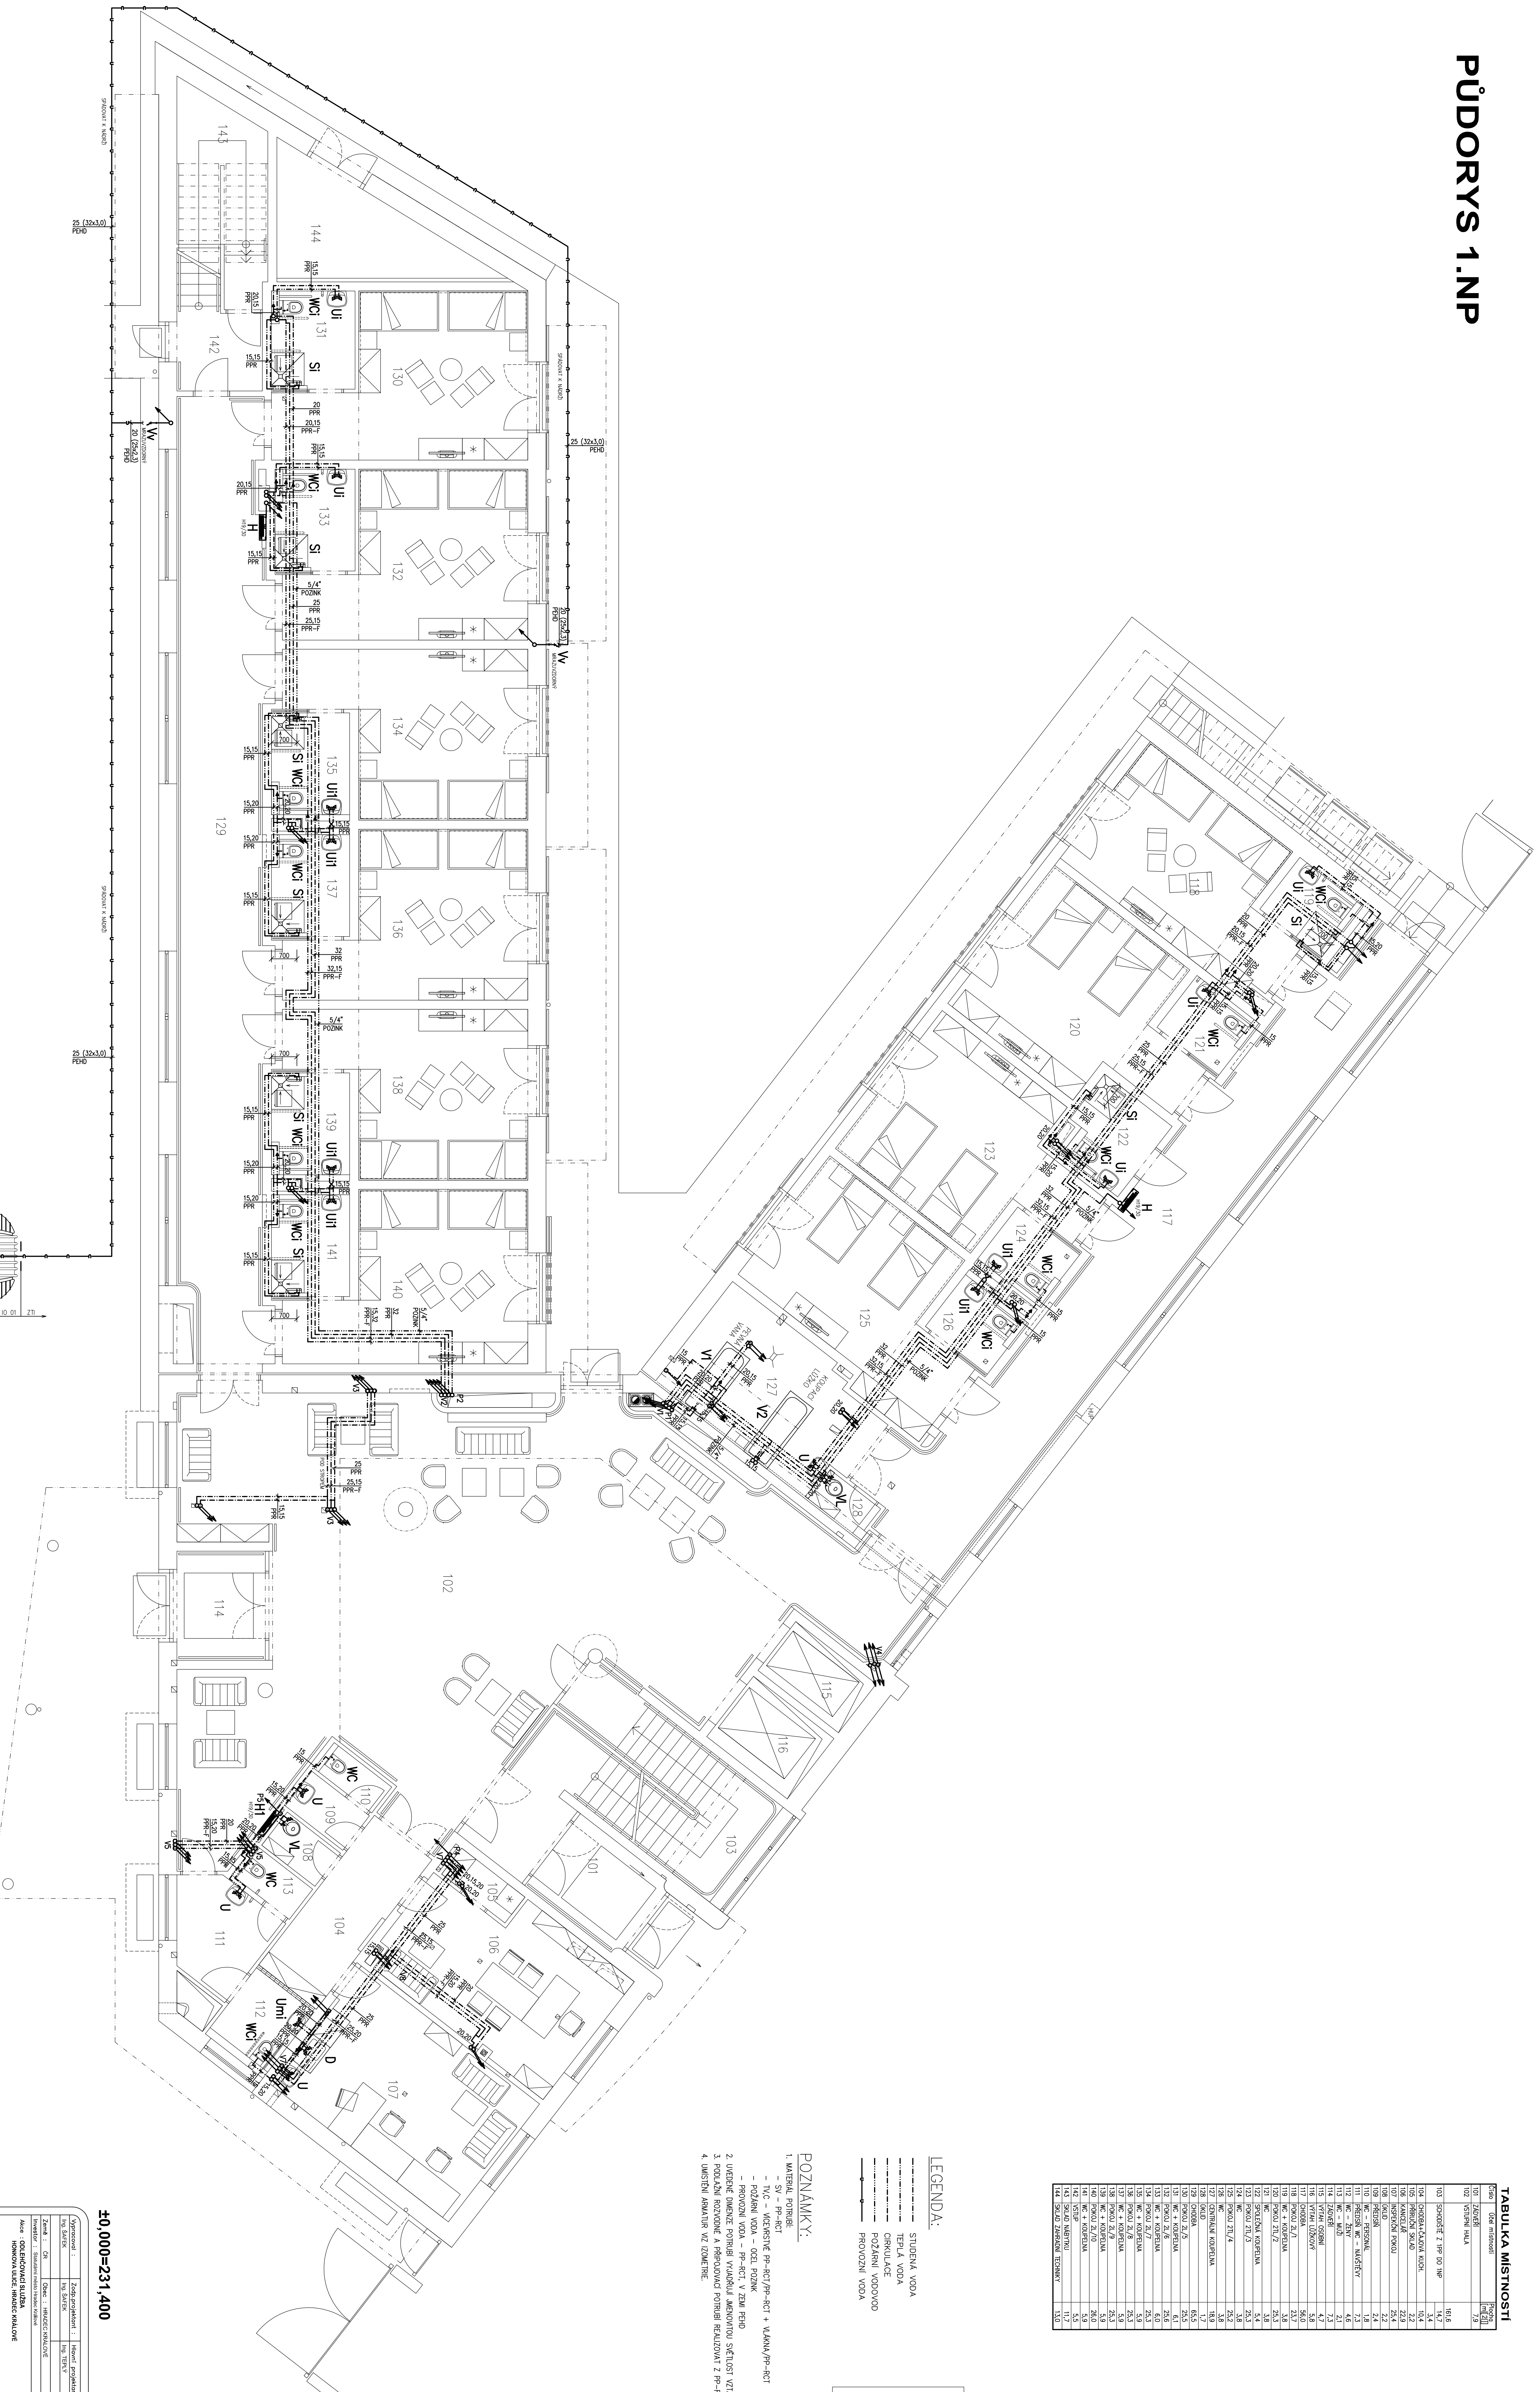

Číslo	Název místnosti	Plocha
-------	-----------------	--------

[illegible]

LEGENDA:


STUDENÁ VODA
TEPLÁ VODA
CIRKULACE
POŽARNÍ VODOVOD
PROVOZNI VODA

PPR 54 (P₁-RC1) (SV)
 PPR 15 = 20x2.3
 PPR 20 = 23x2.8
 PPR 25 = 32x3.6
 PPR 32 = 40x4.5
 PPR 40 = 50x5.6
 PPR 50 = 63x7.1
 PPR-F 53.2 (IVC)
 PPR-F 15 = 20x2.8
 PPR-F 20 = 25x3.5
 PPR-F 25 = 32x4.4
 PPR-F 32 = 40x5.5
 PPR-F 40 = 50x6.9
 PPR-F 50 = 63x8.6

POZNÁMKY:

1. MATERIALI POTREBI:
 - SY – PP-RCT
 - TVC – MEKANSKE PP-RCT/PP-RCT + WLM44/PP-RCT
 - POŽARNI WDA – OCL, POZNAK
 - PROVOZNI WDA – PP-RCT, V ZEM FELD
2. UVERENJE DOKAZUJE POTREBU VARNOSTI SLETOSTI VZVARNOSTI K VARNOSTNI PRODUKCI DNEVNE
3. POUČAJI ZODROVNE A PROJEKCIJE POTREBU REALIZOVATI Z PP-RCT.
4. USTVARNI ASAMBLER VZ. ZODROVNE.

±0,000=231,400

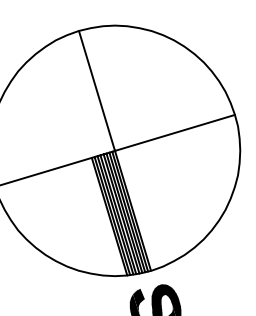[illegible]